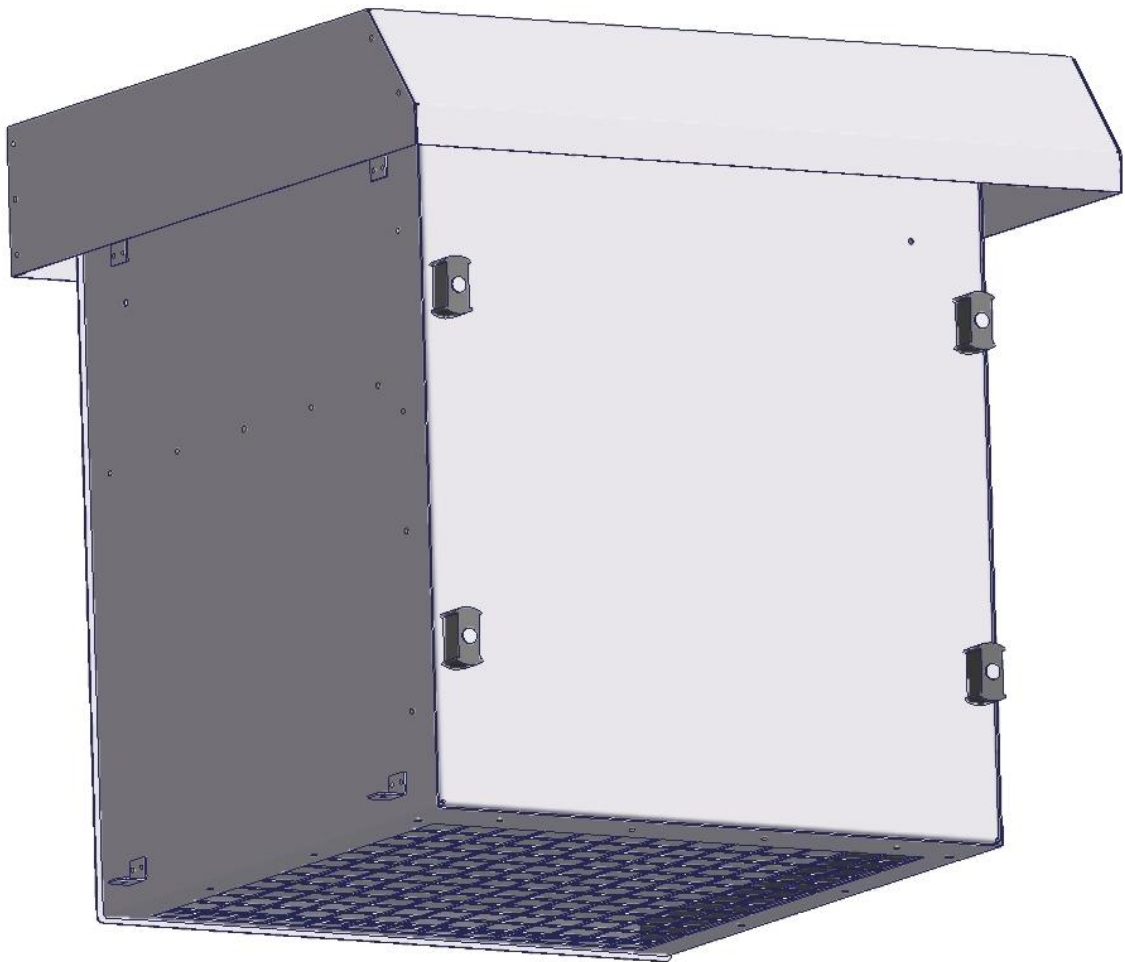


Ventilation system Free Cooling FC-T5 and FC-T2,5 demonstrative drawings



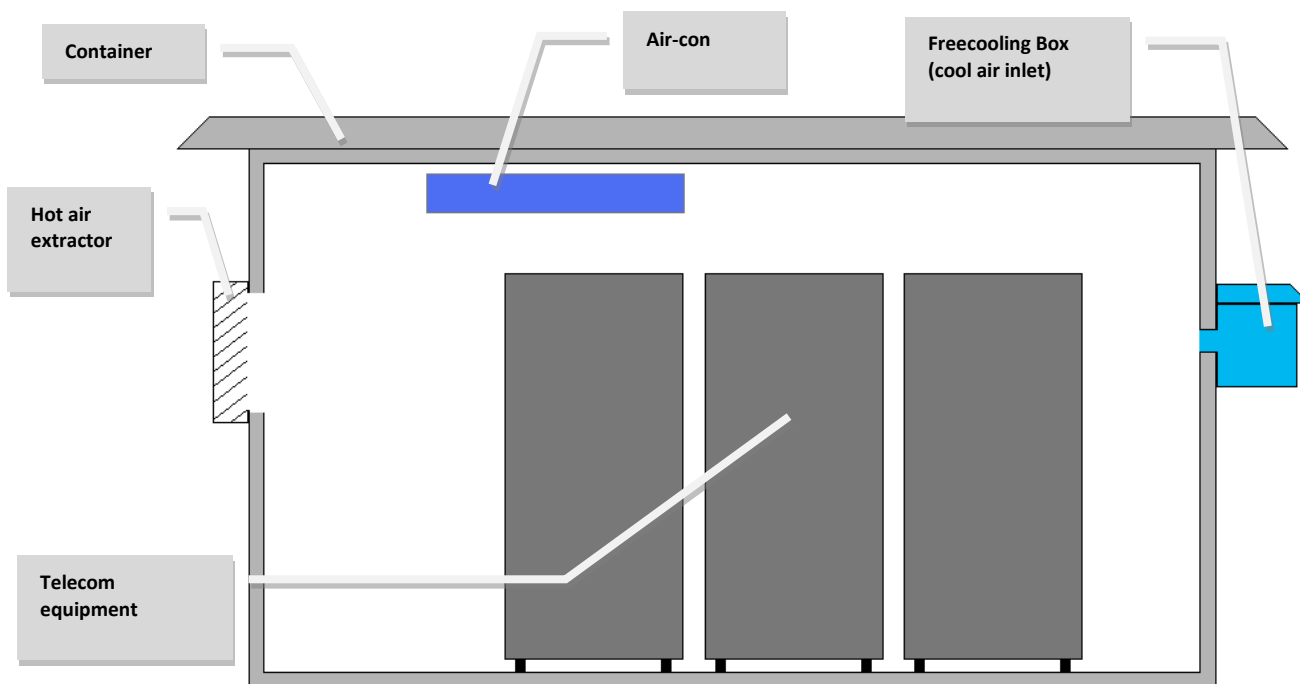


Fig 1. Overview of items layout in a container

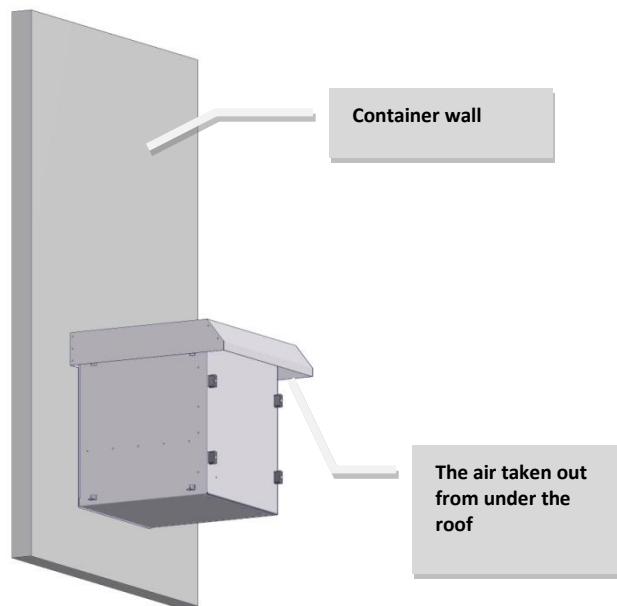


Fig 2. Cool air inlet is located at the bottom of the container

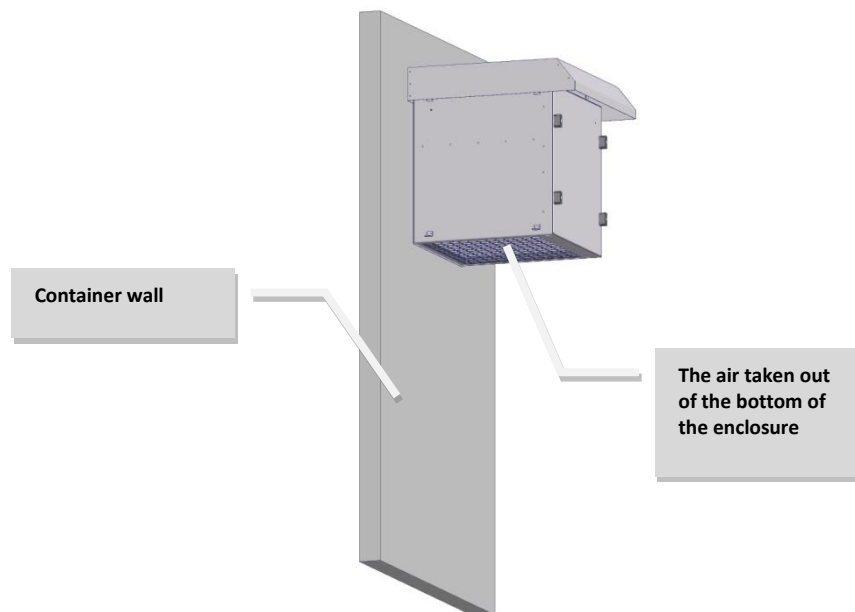


Fig 3. Cool air inlet is located at the top of the container

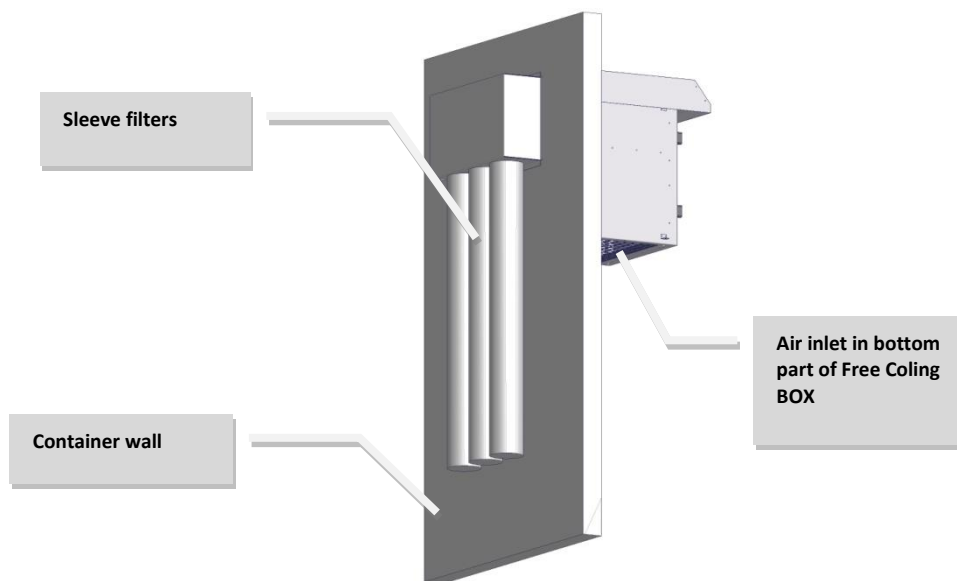


Fig 4. Air inlet in top part of container wall – possibility of using sleeve filters

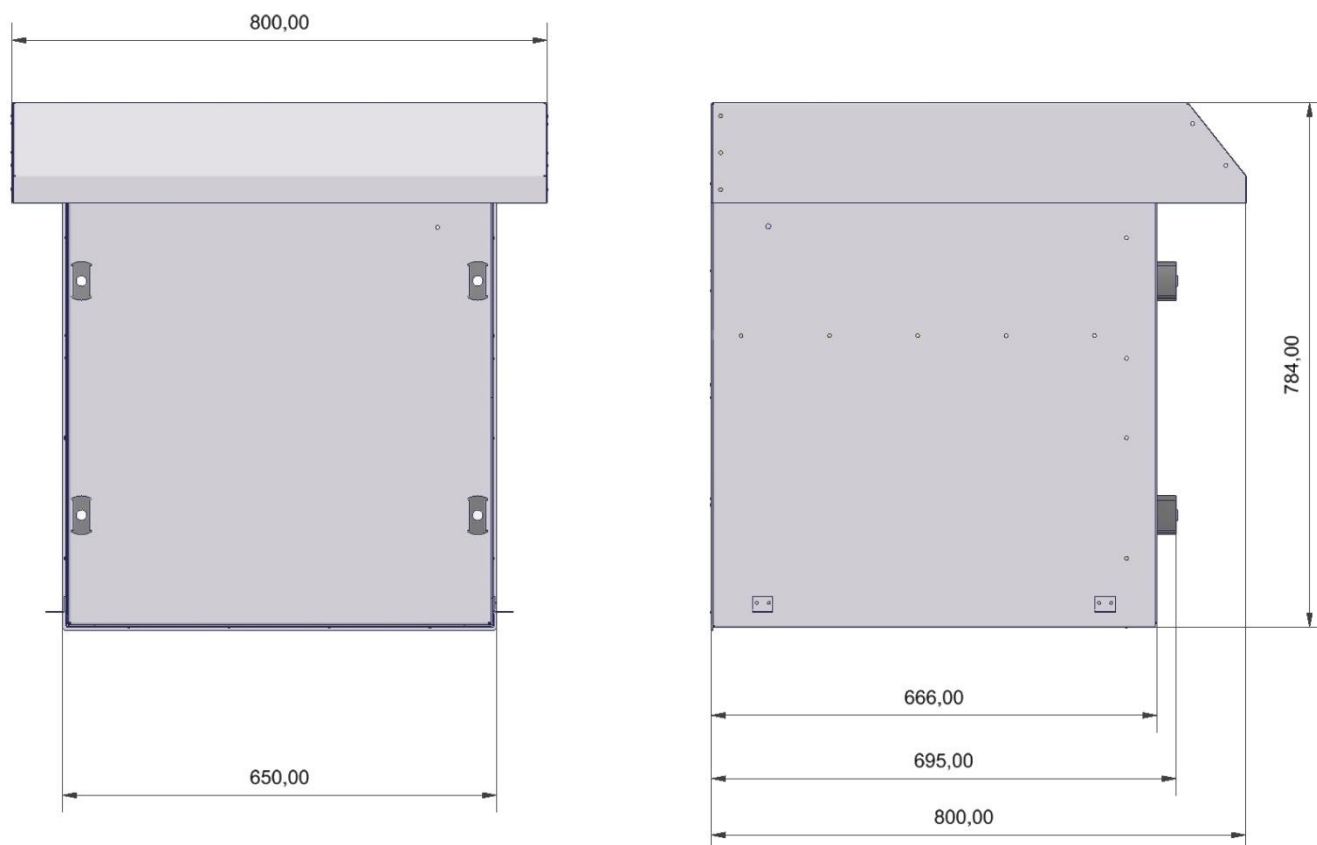


Fig 5. Freecooling Box - dimensions

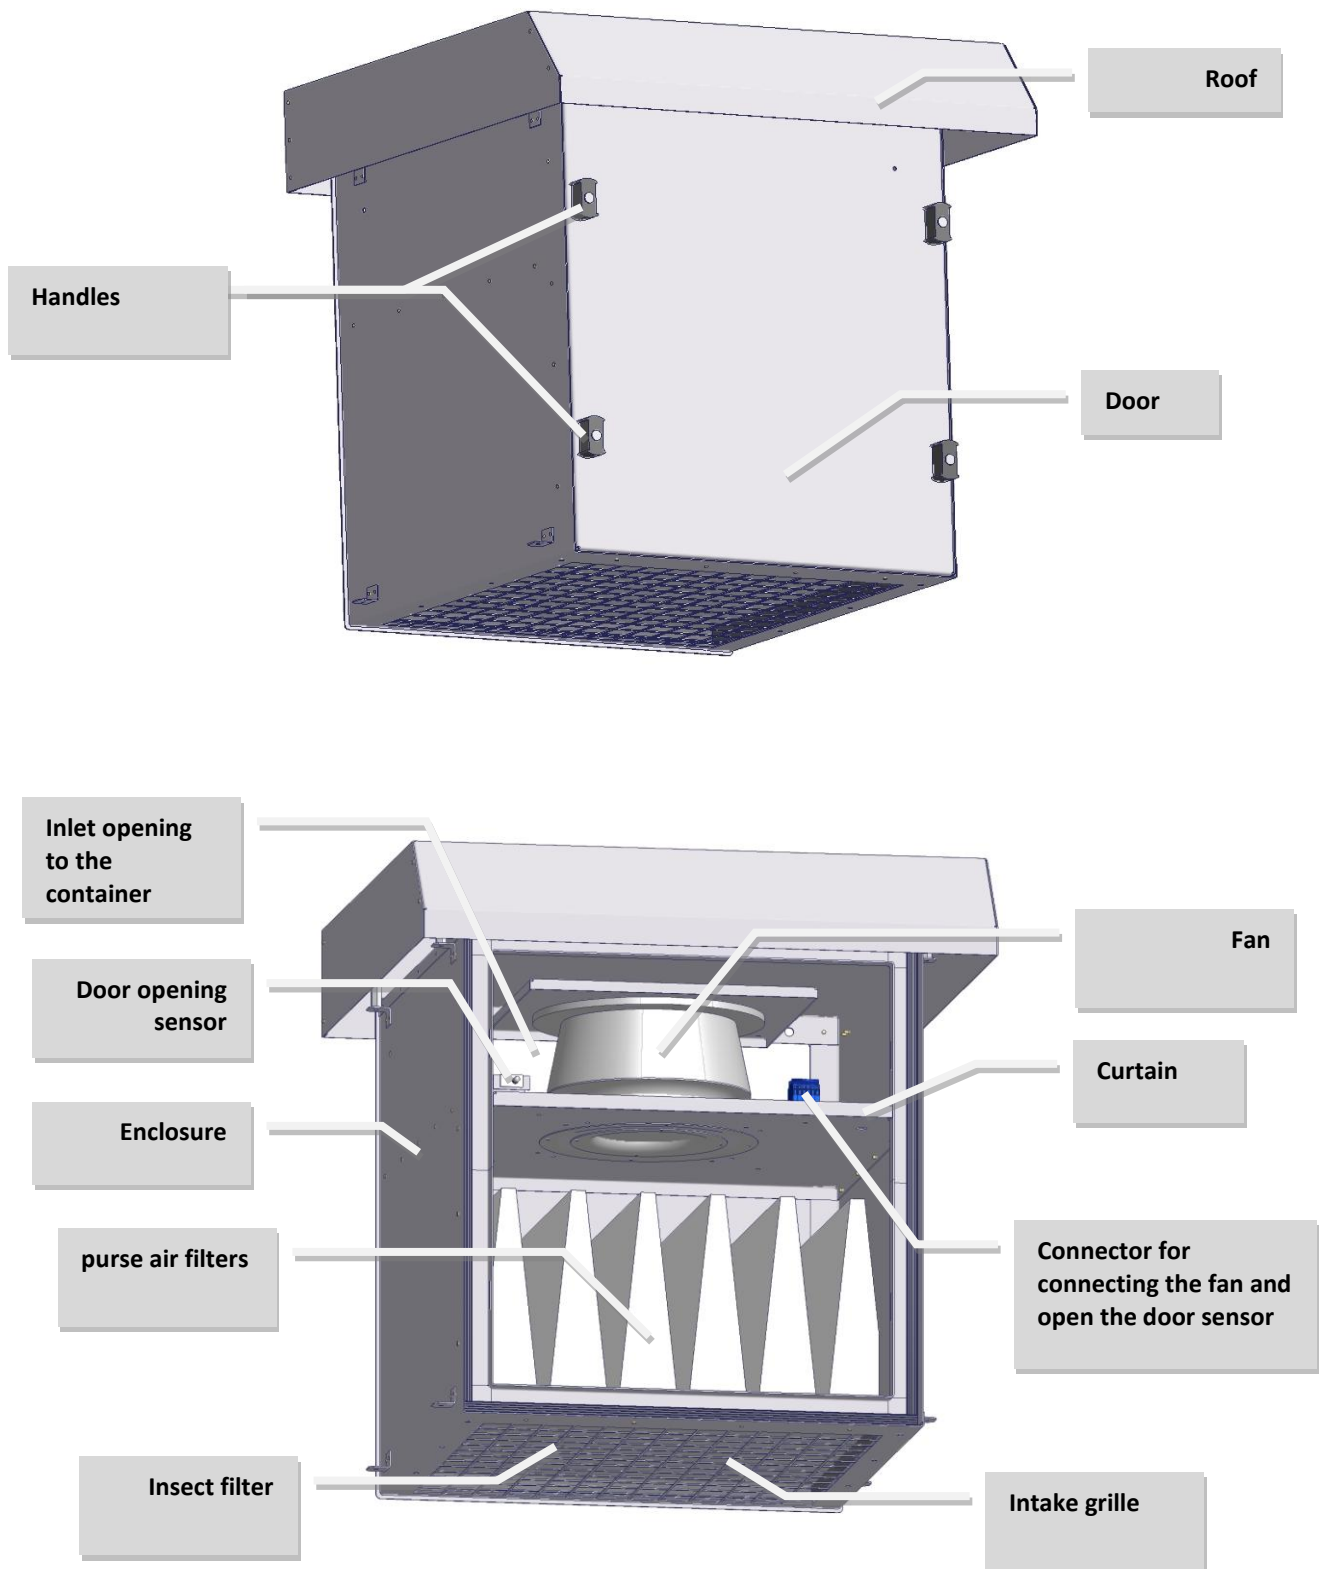


Fig 6. Freecooling BOX